



PRI Construction Materials Technologies LLC

6412 Badger Drive
Tampa, FL 33610
813.621.5777
<https://www.pri-group.com/>

Laboratory Test Report

Report for: Matt Ashley
A&E Metal Roofing Supply South & Echols Metal LLC
230 Lee Road 430
Smith Station, AL 36877
Product Name: 16" SNAP LOCK
Project No.: 2264T0008
Dates Tested: Mar. 19th – Apr. 29th, 2020
Test Methods: UL 2218 (2010)
Results Summary: Compliant: UL 2218 Impact Resistance – Class 4

Purpose: Determine the impact resistance of the identified product in accordance with **UL 2218 (2010) Standard for Impact Resistance of Prepared Roof Covering Materials.**

Test Methods: Testing was conducted in accordance with standard test methods.

<u>Test Method</u>	<u>Title</u>	<u>Year</u>
UL 2218	Standard for Impact Resistance of Prepared Roof Covering Materials.	2010

Sampling: The following materials were received by PRI.

<u>Product</u>	<u>Source</u>	<u>Date</u>	<u>Sampling</u>
26ga. 16" SNAP LOCK panel	Smith Station, AL	Mar. 6, 2020	A&E Metal
#10-16 x 1.5" HWH screws	Smith Station, AL	Mar. 6, 2020	A&E Metal
#10-8 x 1" PH screws	Smith Station, AL	Mar. 6, 2020	A&E Metal

Product Description: 16" SNAP LOCK: 26ga., ASTM A 792 AZ55, Grade 50 steel, through fastened rib panel; 3/4" rib; 36" coverage; Panel drawing shown in Appendix A.

#10-8 x 1" PH: #10-8 x 1" pan head wood screw

#10-16 x 1.5" HWH: #10-16 x 1" HWH wood screws with 0.5" O.D. sealing washers

2264T0008

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. This report shall not be reproduced except in full without the written approval of this laboratory. PRI Construction Materials Technologies LLC assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report.

Specimen Description: Panel: 26ga. 1" Snap Lock attached with #10-8 x 1" PH wood screws 12" o.c. along the nail strip of the male lock in the pre-punched holes. The perimeter was fastened 6" o.c. with #10-16 x1.5" HWH wood screws with sealing washers. See Appendix A for fastening pattern.

Underlayment: ASTM D 226 Type II felt installed with minimum 4" side-lap and 6" end-laps and fastened using 12 ga., 1-1/4" ring shank nails and 32 ga., 1-5/8" tin caps spaced 6" o.c. along the laps and two staggered rows 12" o.c. in the field of the roll.

Deck: CAT 15/32 PS 1-09, APA span rated CDX plywood sheathing installed over No. 2 lumber supports spaced 24" o.c. Decking attached with 0.113" x 2-3/8" ring shank nails spaced 6" o.c. along the perimeter and intermediate supports.

Results:

Physical Properties	Test Method	Results		Requirement
		Depression (in)	Result [Pass/Fail]	
Hail Impact Resistance <i>[Pass/Fail]</i> 2 specimens; 26ga. 16" Snap Lock; 3ft x 3ft test deck Class 4; 2.00±0.01in steel ball ø 1.15±0.04lb steel ball mass 20.0ft steel ball drop 23.71ft-lb impact kinetic energy 2 drops per impact location 6 impact locations	UL 2218 Class 4			Report
	Mid-span, rib	0.3223	Pass	
	Mid pan	0.0439	Pass	
	Adjacent to fastener	0.0465	Pass	
	Mid sidelap	0.2255	Pass	
	Mid-span of plywood	0.0429	Pass	
	Over framing	0.0407	Pass	
	Over fastener	0.0108	Pass	


Notes: None

2264T0008

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. This report shall not be reproduced except in full without the written approval of this laboratory. PRI Construction Materials Technologies LLC assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report.

Statement of Attestation:

The results of testing were determined in accordance with and UL 2218 (2010) *Standard for Impact Resistance of Prepared Roof Covering Materials*. The laboratory test results presented in this report are representative of the material supplied.

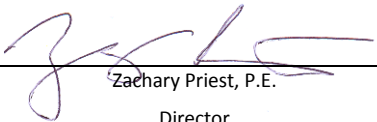Signed: 

Zachary Priest, P.E.
Director


Report Issue History:

Issue #	Date	Pages	Revision Description (if applicable)
Original	05/01/2020	4	NA


2264T0008

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. This report shall not be reproduced except in full without the written approval of this laboratory. PRI Construction Materials Technologies LLC assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report.

16" SNAP LOCK – Dimensions

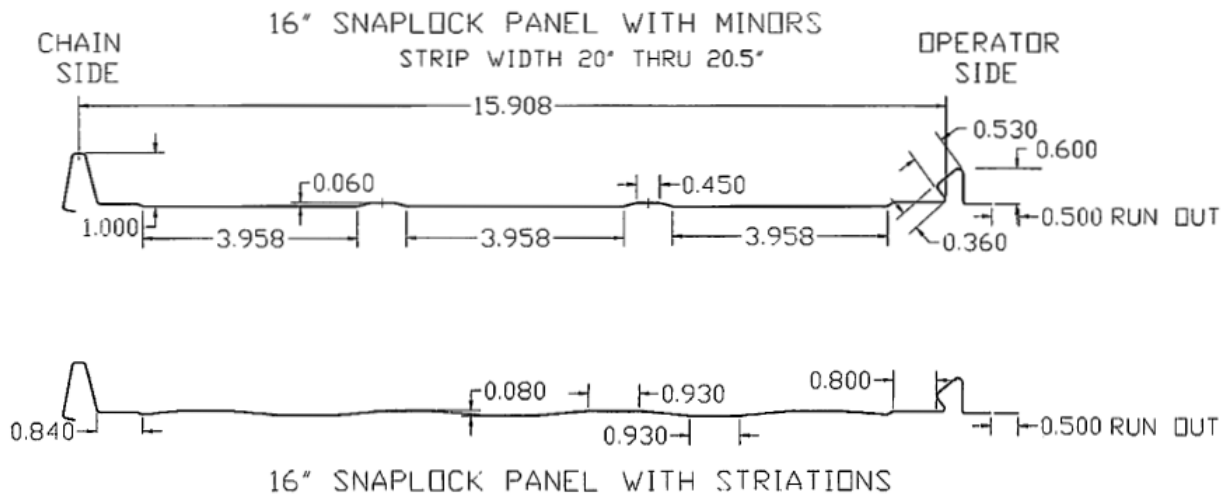

16" SNAP LOCK – Fastening Pattern

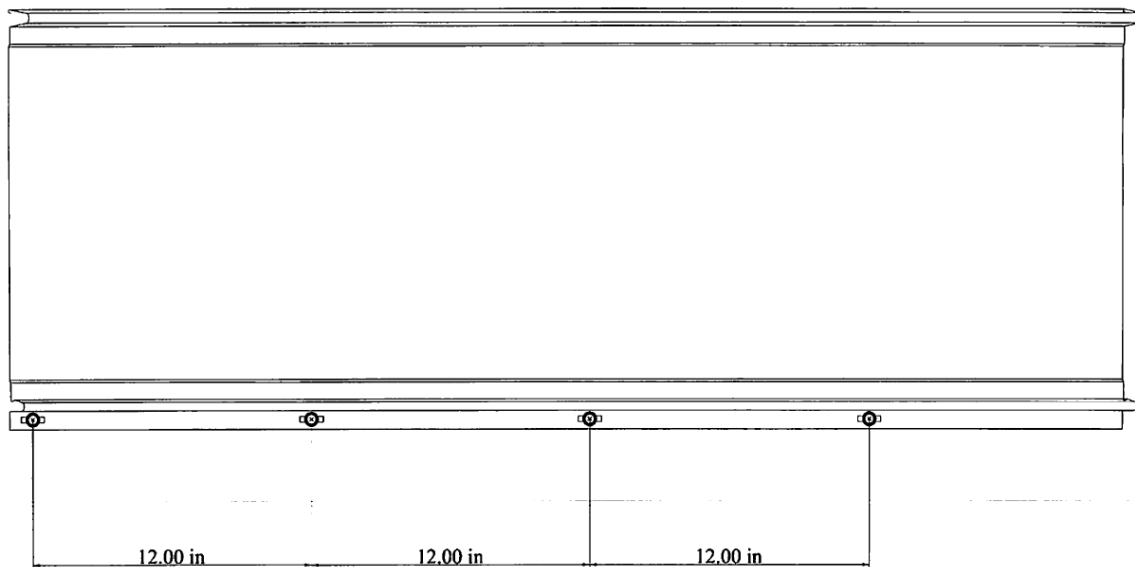

END OF REPORT

2264T0008

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. This report shall not be reproduced except in full without the written approval of this laboratory. PRI Construction Materials Technologies LLC assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report.